




## **APPROVAL**

- $\ \square$  APPROVED, PROCEED WITH FABRICATION
- APPROVED AS NOTED, PROCEED WITH FABRICATION IN ACCORDANCE WITH COMMENTS
- ☐ DISAPPROVED, DO NOT FABRICATE

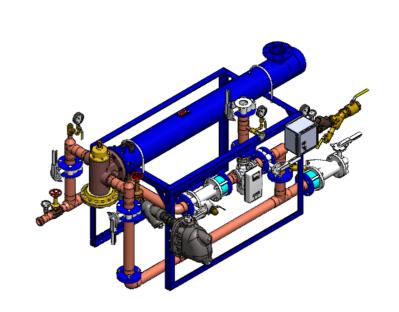

## **FLO-RITE-TEMP**

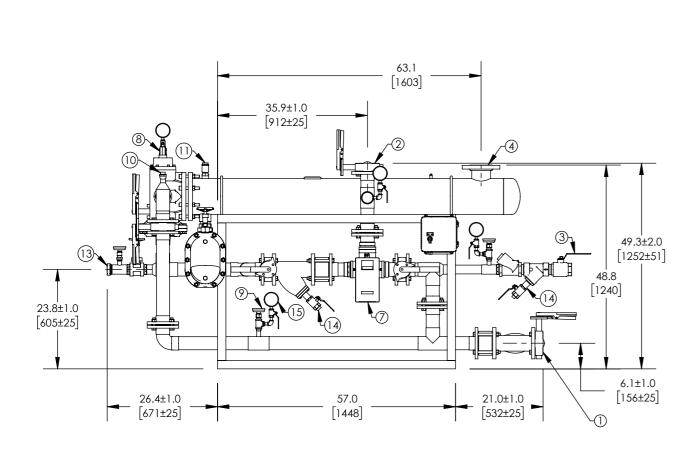

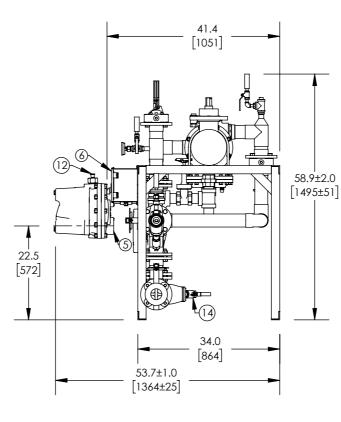

TEM	DESCRIPTION	CONNECTION
1	COLD WATER INLET	3" FLG ANSI 150
2	MIXED WATER OUTLET	3" FLG ANSI 150
3	RECIRC WATER INLET	2" NPT
4	STEAM INLET	4" FLG ANSI 150
5	CONDENSATE OUTLET	2" NPT 20-JD8 F&T
6	ELECTRICAL PANEL	110 VAC @0.7A
7	DRV80	3" NPT
8	CONTROL VALVE	3" NPT
9	THERMOMETER(4)	1/2" NPT
10	CIP CONNECTION(2)	1" NPT
11	AIR VENT	3/4" NPT
12	VACUUM BREAKER	1/2" NPT
13	BYPASS TO DRAIN	2" NPT
14	BLOW DOWN(3)	1" NPT
15	PRESSURE GAUGE (4)	1/4" NPT
	ITEM	MATERIAL
	PIPING	COPPER TYPE "L"
	EXCHANGER SHELL MATL.	CARBON STEEL
	EXCHANGER TUBE MATL.	ADMIRALTY BRASS

## NOTE(S):

- 1. ALL DIMENSIONS +/-0.5 [13] UNLESS OTHERWISE SHOWN.
- 2. COMPLETE ASSEMBLY LEAD FREE COMPLIANT THE WETTED SURFACE OF THIS PRODUCT CONTACTED BY CONSUMABLE WATER CONTAINS LESS THAN ONE QUARTER OF ONE PERCENT (0.25%) OF LEAD BY WEIGHT.
- 3. PACKAGE INCLUDES ALL REQUIRED INLET CHECK VALVES, ISOLATION VALVES, AND STRAINERS ON DOMESTIC SIDE.
- 4. DRV AND ELECTRICAL PANEL ARE PREWIRED TO PROVIDE A SINGLE ELECTRICAL LANDING POINT AT THE PANEL.



Copyright © 2010 ARMSTRONG INTERNATIONAL, INC.

FRT812080

DECIMAL .XXXX ± .0005 ..XXX ± .005 ..XX ± .015 ...XX ± .015 ...XX .010 DRAWN RELEASED

DATE NAME

MATERIAL 5/18/2015

CWF55983

<sup>V</sup> C

SALES

SHEET 1 OF 1