

# DIMENSIONS & DATA CERTIFIED FOR:

Representative:

Order:

Customer:


Order:

Project:

Requirements:


By:

Date:

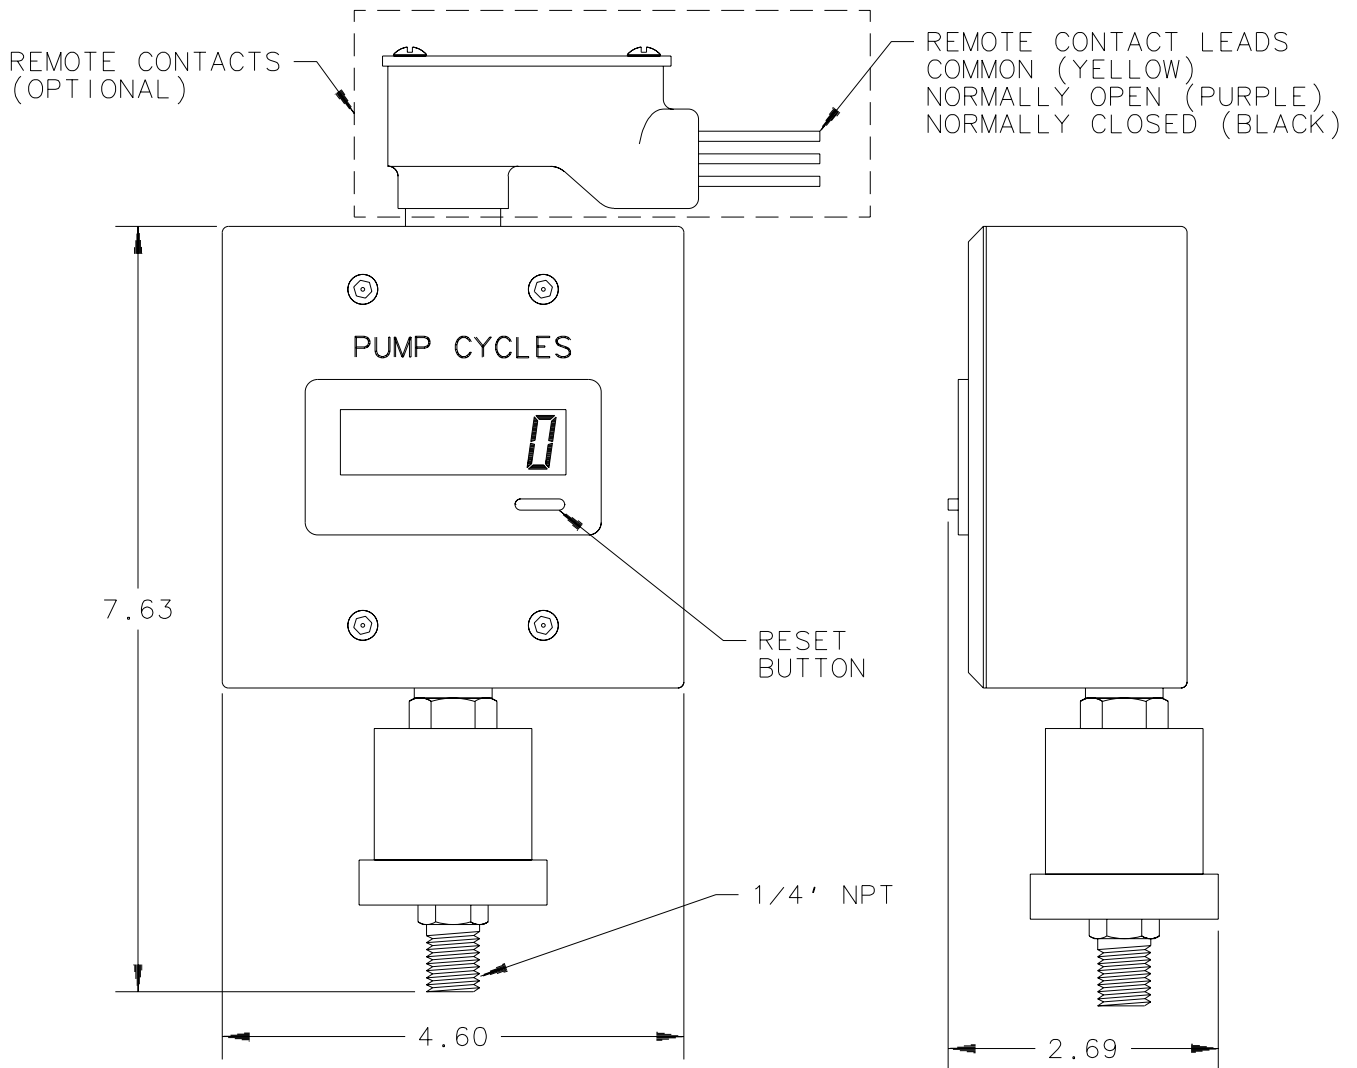

**NOTES:**

1. NEMA 4 ENCLOSURE
2. 5 YEAR LITHIUM BATTERY
3. MINIMUM 10 PSIG PUMP DISCHARGE REQUIRED FOR OPERATION
4. MAX. SYSTEM PRESSURE: 250 PSIG WOG  
125 PSIG WSP
5. AMBIENT TEMP: -22°F TO 176°F
6. INSTRUMENTATION PIGTAIL REQUIRED FOR ALL APPLICATIONS.

 Armstrong Fluid Handling, Inc. Three Rivers, MI. 49093 Telephone (616) 279-3601 Fax (616) 279-3150 Posted on Armstrong's homepage <a href="http://www.armstrong-intl.com">www.armstrong-intl.com</a>		
Product	CDF No.	Date
DIGITAL CYCLE COUNTER OPEN SYSTEM	CDF1054	9/17/01
		Rev. A